



VISUALIZATION

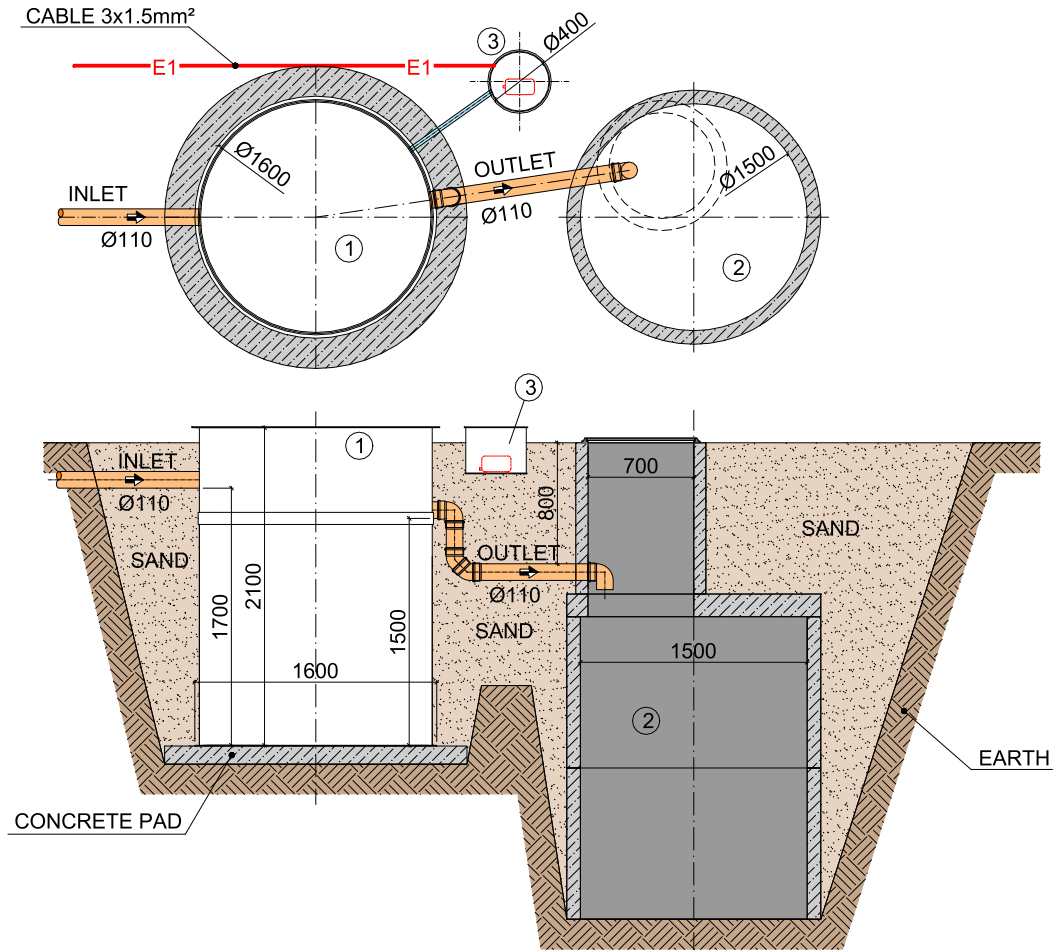

EXPLICATION:


1. WASTEWATER TREATMENT PLANT AT-10 ( $\varnothing 1600$ MM)
2. INFILTRATION WELL ( $\varnothing 1000$ MM- $\varnothing 2000$ ,  
DEPENDS ON THE FILTRATION PROPERTIES OF THE EXISTING SOILS)
3. AIR BLOWER TANK ( $\varnothing 400$ MM)

VISUALIZATION

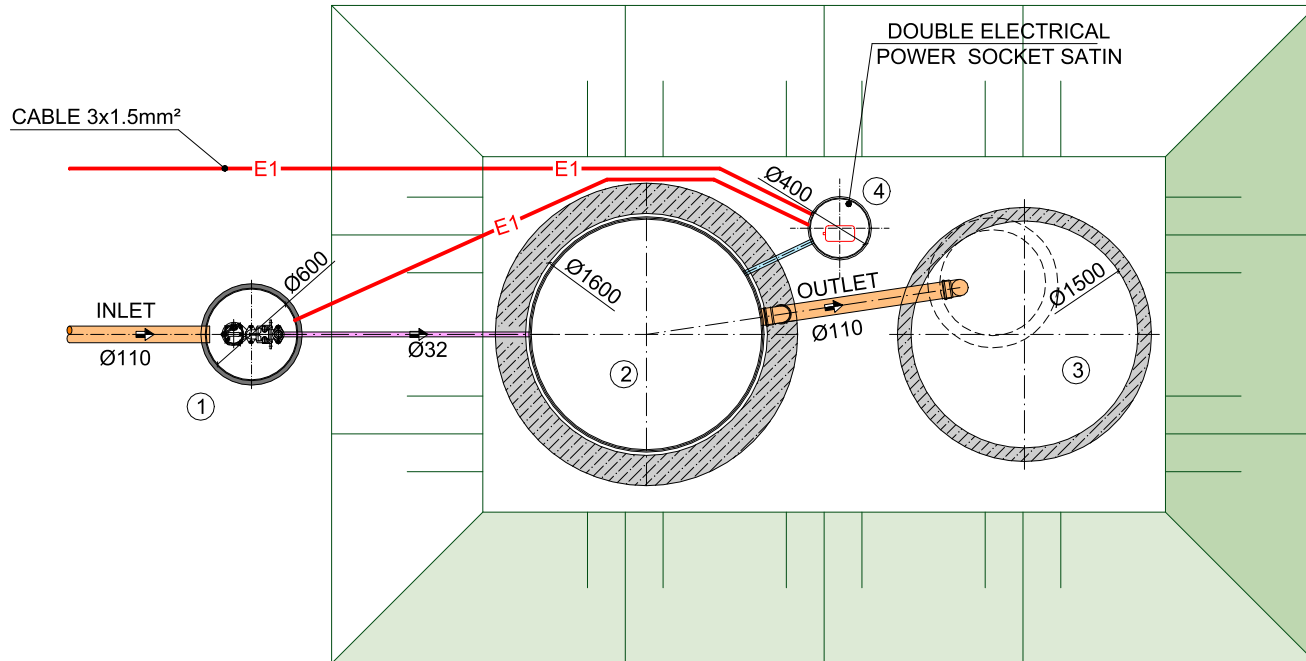

EXPLICATION:

1. PUMP STATION (Ø600MM)
2. WASTEWATER TREATMENT PLANT AT-10 (Ø1600MM)
3. INFILTRATION WELL (Ø1000MM-Ø2000, DEPENDS ON THE FILTRATION PROPERTIES OF THE EXISTING SOILS)
4. AIR BLOWER TANK (Ø400MM)

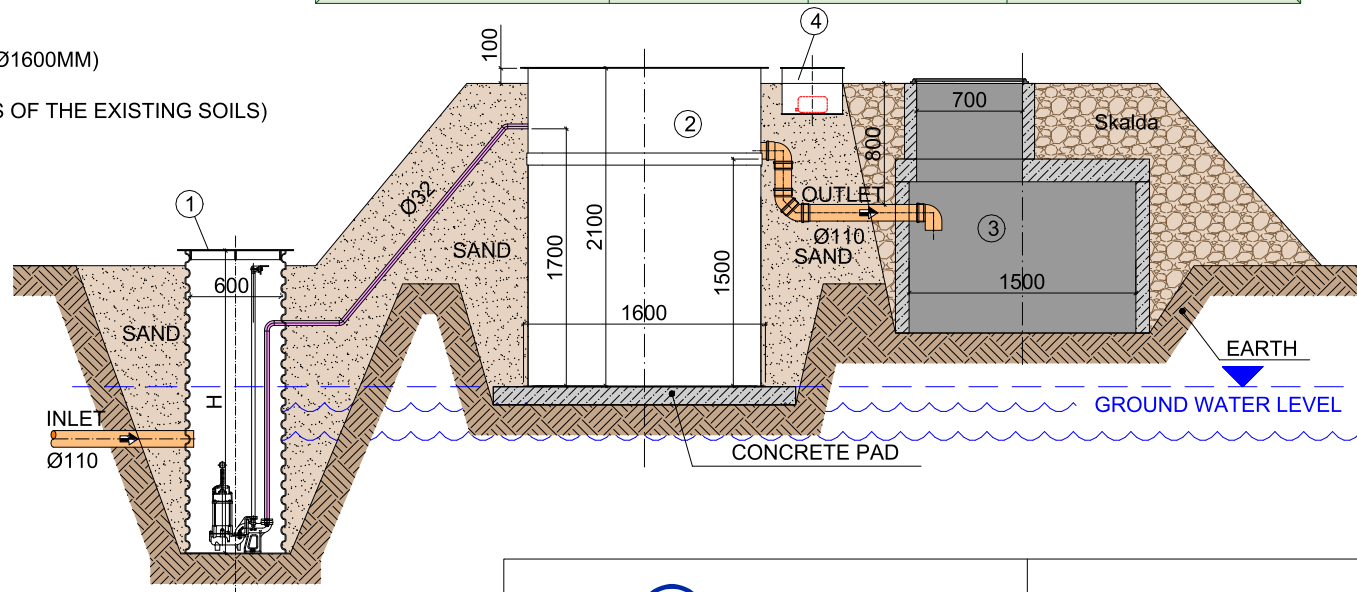

NOTE:

THE HEIGHT OF THE PUMPING STATION (H) DEPENDS ON THE SPECIFIC SITE CONDITIONS



AT-10 INSTALLATION DIAGRAM B